

## **Section 4**


# **Design Guide Plates and Data Sheets: General Rooms**

Guide  
Plate  
Series

- 4 - 1 ..... Administrative Offices  
Equipment & Utility Plan
  - 4-1a..... Chief of SPD  
Design Standards  
Equipment Guide List
  - 4-1b..... Assistant Chief of SPD  
Design Standards  
Equipment Guide List
  - 4-1c..... Clerical Staff  
Design Standards  
Equipment Guide List
- 4 - 2 ..... Lockers, Toilet, & Shower Room  
(Soiled Area, Unisex)  
Equipment & Utility Plan  
Design Standards  
Equipment Guide List
- 4 - 3 ..... Lockers, Toilet, & Shower Room  
(Clean Area, Women)  
Equipment & Utility Plan  
Design Standards  
Equipment Guide List
- 4 - 4 ..... Lockers, Toilet, & Shower Room  
(Clean Area, Men)  
Equipment & Utility Plan  
Design Standards  
Equipment Guide List

# Equipment & Utility Plan Administrative Offices

NOTE: THE BREAKDOWN OF AREAS ARE AS FOLLOWS:  
CHIEF OF SPD = 11.1 NSM (120 NSF)  
ASSISTANT CHIEF OF SPD = 9.3 NSM (100 NSF)  
FIRST CLERK = 7.4 NSM (80 NSF)  
ANY ADDITIONAL CLERK ADD 4.6 NSM (50 NSF)  
COMPUTER OPERATOR = 6 NSM (64 NSF)

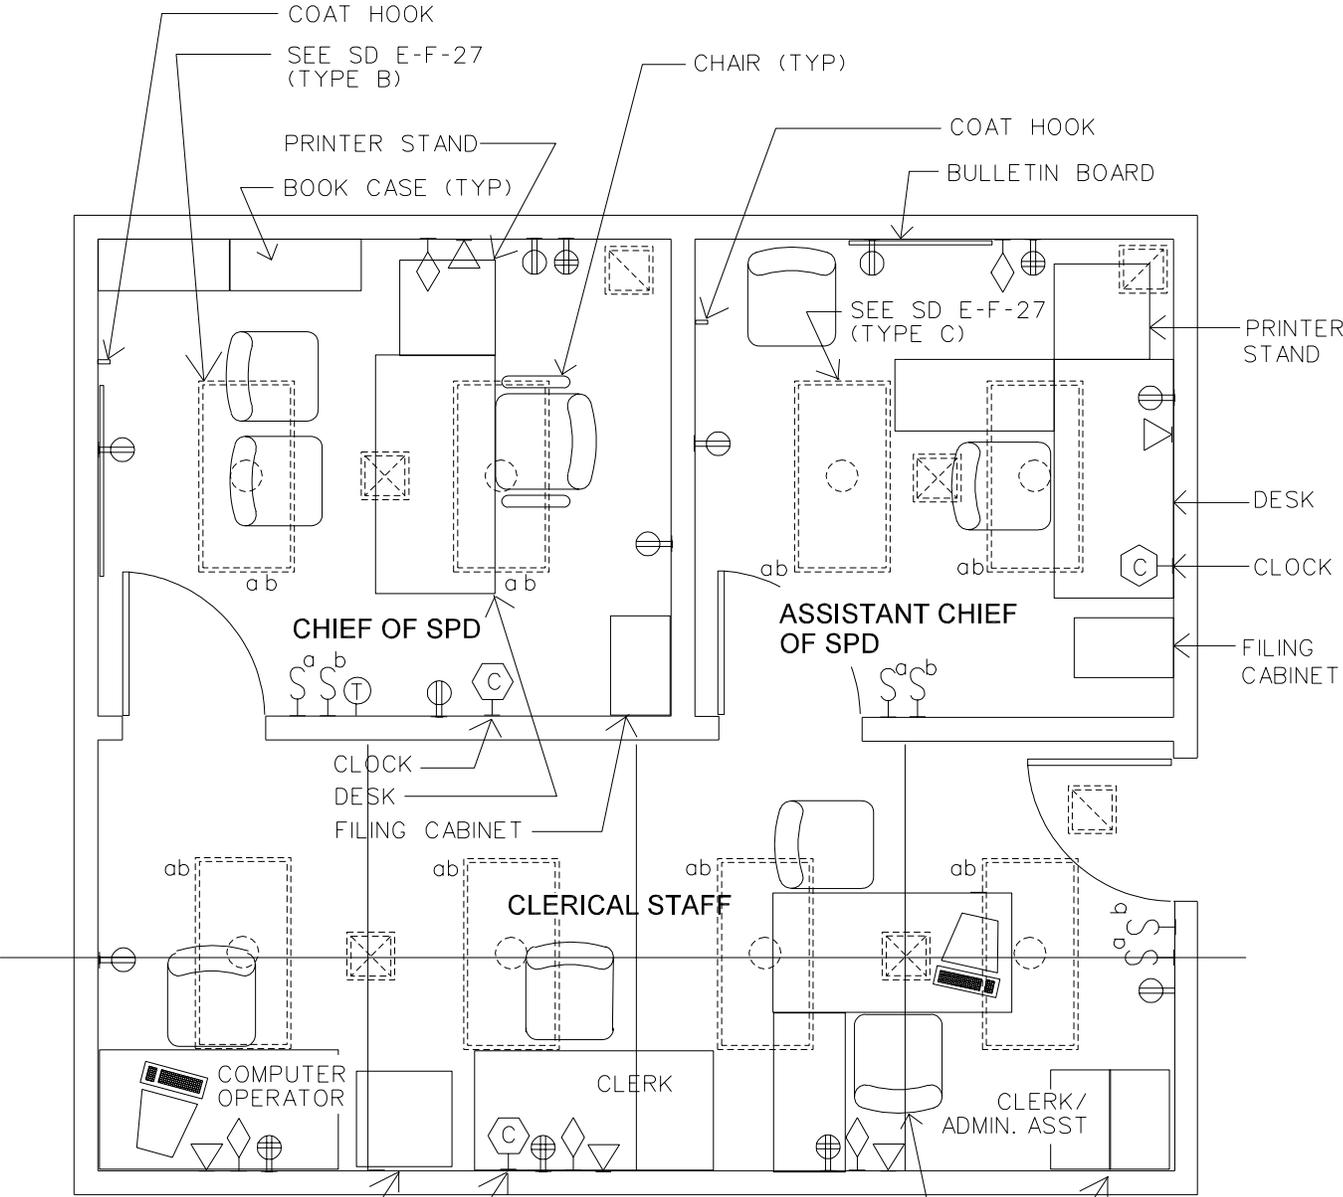

**38.4 NSM  
414 NSF**



# Design Standards

## Chief of SPD

### ARCHITECTURAL

Ceiling	AT	Wainscot	-
Ceiling Height	2700 (9'-0")	Base	RB
Wall Finish	GWB/W/PL (SC)	Floor Finish	CP/VCT
Notes:		Slab Depression	-

### SPECIAL EQUIPMENT

#### ELECTRICAL

##### Lighting

General	70 FC - 4 W/SF
Special	-

Notes:

##### Power

General	2000 W RECEPTACLES
Emergency	-

#### COMMUNICATIONS

ADP	YES	Telephone	YES
Radio	-	Intercom	-
Notes:		Public Address	-

#### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	50%
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	30%
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	(0)
Noise Criteria	NC 40	AC Load - Equipment	0.4645 W/SM
Steam	-	Number of People	5
Notes:		Special Exhaust	-

#### PLUMBING AND MEDICAL GASES

Cold Water	-	Sanitary Drain	-
Hot Water	-	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List

## Chief of SPD

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						OFFICE, CHIEF, SPD
VV		1				DESK, DOUBLE PEDESTAL, APPROX., 1524 MM X 762 MM X 749 MM (60" X 30" X 29-1/2")
VV		1				CHAIR, ROTARY, WITH ARMS
VV		3				CHAIR, STRAIGHT, WITH ARMS
VV		1				BOOKCASE, SECTIONAL, EACH SECTION, 838 MM X 330 MM X 381 MM (33" X 13" X 15") WITH 254 MM (10") BASE
VV		1				TABLE, OFFICE, 1524 MM X 762 MM X 749 MM (60" X 30" X 29-1/2")
VV		1				HOOK, COAT, WALL MOUNTED
VV		1				CRT, COMPUTER SYSTEM, WITH KEYBOARD
VV		1				PRINTER, COMPUTER SYSTEM
VV		1				STAND, COMPUTER PRINTER, APPROX., 610 MM X 610 MM X 660 MM (24" X 24" X 26")
CC		1				RECEPTACLE, ELECTRICAL, QUADRAPLEX, FOR COMPUTER EQUIPMENT ITEMS (PG-08-1, MCS 16140; H-08-3, CS 866-1)
VV		1				CLOCK, BATTERY OPERATED
CC	AR					RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP (PG-08-1, MCS 16140; H-08-3, CS 801-3)

# Design Standards

## Assistant Chief of SPD

### ARCHITECTURAL

Ceiling	AT	Wainscot	-
Ceiling Height	2700 (9'-0")	Base	RB
Wall Finish	GWB/W/PL (SC)	Floor Finish	CP/VCT
Notes:		Slab Depression	-

### SPECIAL EQUIPMENT

#### ELECTRICAL

##### Lighting

General	70 FC - 4 W/SF
Special	-

Notes:

##### Power

General	2000 W RECEPTACLES
Emergency	-

#### COMMUNICATIONS

ADP	YES	Telephone	YES
Radio	-	Intercom	-
Notes:		Public Address	-

#### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	50%
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	30%
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	(0)
Noise Criteria	NC-40	AC Load - Equipment	0.4645 W/SM
Steam	-	Number of People	5
Notes:		Special Exhaust	-

#### PLUMBING AND MEDICAL GASES

Cold Water	-	Sanitary Drain	-
Hot Water	-	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List

## Assistant Chief of SPD

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						OFFICE, ASSISTANT CHIEF, SPD
VV		1				DESK, DOUBLE PEDESTAL, APPROX., 1524 MM X 762 MM X 749 MM (60" X 30" X 29-1/2")
VV		1				CHAIR, ROTARY, WITH ARMS
VV		1				CHAIR, STRAIGHT, WITH ARMS
VV		1				BOOKCASE, SECTIONAL, EACH SECTION, 838 MM X 330 MM X 381 MM (33" X 13" X 15") WITH 254 MM (10") BASE
VV		1				HOOK, COAT, WALL MOUNTED
VV		1				CRT, COMPUTER SYSTEM, WITH KEYBOARD
VV		1				PRINTER, COMPUTER SYSTEM
VV		1				STAND, COMPUTER PRINTER, APPROX., 610 MM X 610 MM X 660 MM (24" X 24" X 26")
CC		1				RECEPTACLE, ELECTRICAL, QUADRAPLEX, FOR COMPUTER EQUIPMENT ITEMS (PG-08-1, MCS 16140; H-08-3, CS 866-1)
VV		1				CLOCK, BATTERY OPERATED
CC	AR					RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP (PG-08-1, MCS 16140; H-08-3, CS 801-3)

# Design Standards Clerical Staff

## ARCHITECTURAL

Ceiling	AT	Wainscot	-
Ceiling Height	2700 (9'-0")	Base	RB
Wall Finish	GWB/W/PL (SC)	Floor Finish	CP/VCT
Notes:		Slab Depression	-

## SPECIAL EQUIPMENT

### ELECTRICAL

#### Lighting

General	70 FC - 4 W/SF
Special	-

Notes:

#### Power

General	2000 W RECEPTACLES
Emergency	-

### COMMUNICATIONS

ADP	YES	Telephone	YES
Radio	-	Intercom	-
Notes:		Public Address	-

### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	50%
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	30%
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	(0)
Noise Criteria	NC-40	AC Load - Equipment	0.4645 W/SM
Steam	-	Number of People	5
Notes:		Special Exhaust	-

### PLUMBING AND MEDICAL GASES

Cold Water	-	Sanitary Drain	-
Hot Water	-	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List

## Clerical Staff

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						CLERICAL STAFF
VV			2	1	1	DESK, TYPEWRITER, DOUBLE PEDESTAL
VV	1					DESK, DOUBLE PEDESTAL, APPROX., 1524 MM X 762 MM X 749 MM (60" X 30" X 29-1/2")
VV	1					CHAIR, ROTARY, WITH ARMS
VV			2	1	1	CHAIR, ROTARY, WITHOUT ARMS
VV			4	3	2	CHAIR, STRAIGHT, WITHOUT ARMS
VV			3	2	1	CABINET, FILING (LETTER SIZE) 5 DRAWER, APPROX., 381 MM X 635 MM X 1524 MM (15" X 25" X 60")
VV			2	1	1	CABINET, FILING (LEGAL SIZE) 5 DRAWER, 457 MM X 635 MM X 1524 MM (18" X 25" X 60")
VV	1					HOOK, COAT, WALL MOUNTED
VV	1					CRT, COMPUTER SYSTEM, WITH KEYBOARD
VV	1					PRINTER, COMPUTER SYSTEM
VV	1					STAND, COMPUTER PRINTER, APPROX., 610 MM X 610 MM X 660 MM (24" X 24" X 26")
CC	1					RECEPTACLE, ELECTRICAL, QUADRAPLEX, FOR COMPUTER EQUIPMENT ITEMS (PG-08-1, MCS 16140; H-08-3, CS 866-1)
VV	AR					CLOCK, BATTERY OPERATED
CC	AR					RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP (PG-08-1, MCS 16140; H-08-3, CS 801-3)



# Design Standards

## Lockers, Toilet, & Shower Room (Soiled Area)

### ARCHITECTURAL

Ceiling	PCP/AT	Wainscot	CT 1200 (4'-0")*
Ceiling Height	2700 (9'-0")	Base	CT
Wall Finish	CT/GWB	Floor Finish	CT/VCT
Notes:		Slab Depression	-

UNISEX FACILITY, ENCLOSED TOILET

\*WAINSCOT FOR TOILET AREA ONLY

### ELECTRICAL

#### Lighting

General	30 FC - 2 W/SF
Special	-

Notes:

#### Power

General	400 W
Emergency	-

### COMMUNICATIONS

ADP	-	Telephone	-
Radio	-	Intercom	-
Notes:		Public Address	-

### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	-
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	-
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	NEGATIVE
Noise Criteria	NC-40	AC Load - Equipment	0.0929 W/SM
Steam	-	Number of People	1
Notes:		Special Exhaust	-

### PLUMBING AND MEDICAL GASES

Cold Water	YES	Sanitary Drain	YES
Hot Water	YES	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List

## Lockers, Toilet, & Shower Room (Soiled Area)

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						LOCKERS, LOUNGE, TOILET AND SHOWER FACILITIES - MALE
						NOTE: CONTIGUOUS TO SOILED RECEIVING AND DECONTAMINATION AREA.
T-B	CC	AR				LOCKER, STEEL, SLOPING TOP, 12"W X 21"D X 72"H (PG-08-1, MCS 10500; H-08-4, SD 61)
P-415	CC	1	2	2	1	LAVATORY, STRAIGHT BACK (PG-08-1, MCS 15450; H-08-4, SD 53)
	CC	1	2	2	1	MIRROR, 406 MM X 508 MM (16" X 20"), WITH INTEGRAL SHELF, OVER LAVATORY (PG-08-1, MCS 10800; H-08-4, SD 15)
	VV	1	2	2	1	DISPENSER, SOAP, LIQUID, WALL MOUNTED
	CC	1	2	2	1	DISPENSER, PAPER TOWEL AND DISPOSAL COMBINATION UNITS (PG-08-1, MCS 10800)
	CC	1	2	2	1	RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP, WITH GROUND FAULT INTERRUPTER, ADJACENT TO LAVATORY (PG-08-1, MCS 16140; H-08-3, CS 801-3)
						WHEELCHAIR WATER CLOSETS WILL BE IN ACCORDANCE WITH THE APPROPRIATE SPACE PROGRAM, P-103 WILL BE USED FOR BOTH CONVENTIONAL AND WHEELCHAIR INSTALLATIONS.
P-103	CC	1				WATER CLOSET, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				ENCLOSURE, TOILET, CEILING HUNG (PG-08-1, MCS 10162; H-08-3, CD 13; H-08-4, SD 12)
	CC	1				BAR, GRAB FOR WATER CLOSET (PG-08-1, MCS 10800; H-08-4, SD 12, 14B & 14F)
	CC	1				DISPENSER, TOILET TISSUE, DOUBLE ROLL (PG-08-1, MCS 10800; H-08-4, SD 12)
P-201	CC	1				URINAL, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				STALL, SHOWER (PG-08-1, MCS 10170; H-08-4, SD 13A)
P-702	CC	1				SHOWER, BATH FIXTURE, WALL MOUNTED, CONCEALED SUPPLIES (PG-08-1, MCS 15450; H-08-4, SD 13A)
	CC	1				ROD, CURTAIN, TUB OR SHOWER (PG-08-1, MCS 10800)
	CC	1				DISH, SOAP, SURFACE MOUNTED (PG-08-1, MCS 10800)
	CC	1	2	2	1	HOOK, TOWEL (PG-08-1, MCS 10800)
	CC	1				HOOK, CLOTHES (PG-08-1, MCS 10800)
	VV	1				HAMPER, SOILED LINEN, WITH HINGED SELF CLOSING TOP, 20" DIA.
	VV	1				RECEPTACLE, WASTE, WITH SWINGING TOP, 16" X 16"

# Equipment Guide List


## Lockers, Toilet, & Shower Room (Soiled Area)

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						LOCKERS, LOUNGE, TOILET AND SHOWER FACILITIES FEMALE
						NOTE: CONTIGUOUS TO SOILED RECEIVING AND DECONTAMINATION AREA.
T-B	CC	AR				LOCKER, STEEL, SLOPING TOP, 12"W X 21"D X 72"H (PG-08-1, MCS 10500; H-08-4, SD 61)
P-415	CC	1	2	2	1	LAVATORY, STRAIGHT BACK (PG-08-1, MCS 15450; H-08-4, SD 53)
	CC	1	2	2	1	MIRROR, 406 MM X 508 MM (16" X 20"), WITH INTEGRAL SHELF, OVER LAVATORY (PG-08-1, MCS 10800; H-08-4, SD 15)
	VV	1	2	2	1	DISPENSER, SOAP, LIQUID, WALL MOUNTED
	CC	1	2	2	1	DISPENSER, PAPER TOWEL AND DISPOSAL COMBINATION UNITS (PG-08-1, MCS 10800)
	CC	1	2	2	1	RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP, WITH GROUND FAULT INTERRUPTER, ADJACENT TO LAVATORY (PG-08-1, MCS 16140; H-08-3, CS 801-3)
						WHEELCHAIR WATER CLOSETS WILL BE IN ACCORDANCE WITH THE APPROPRIATE SPACE PROGRAM, P-103 WILL BE USED FOR BOTH CONVENTIONAL AND WHEELCHAIR INSTALLATIONS.
P-103	CC	1				WATER CLOSET, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				ENCLOSURE, TOILET, CEILING HUNG (PG-08-1, MCS 10162; H-08-3, CD 13; H-08-4, SD 12)
	CC	1				BAR, GRAB FOR WATER CLOSET (PG-08-1, MCS 10800; H-08-4, SD 12, 14B & 14F)
	CC	1				DISPENSER, TOILET TISSUE, DOUBLE ROLL (PG-08-1, MCS 10800; H-08-4, SD 12)
	CC	1				STALL, SHOWER (PG-08-1, MCS 10170; H-08-4, SD 13A)
P-702	CC	1				SHOWER, BATH FIXTURE, WALL MOUNTED, CONCEALED SUPPLIES (PG-08-1, MCS 15450; H-08-4, SD 13A)
	CC	1				ROD, CURTAIN, TUB OR SHOWER (PG-08-1, MCS 10800)
	CC	1				DISH, SOAP, SURFACE MOUNTED (PG-08-1, MCS 10800)
	CC	1	2	2	1	HOOK, TOWEL (PG-08-1, MCS 10800)
	CC	1				HOOK, CLOTHES (PG-08-1, MCS 10800)
	VV	1				HAMPER, SOILED LINEN, WITH HINGED SELF CLOSING TOP, 20" DIA.
	VV	1				RECEPTACLE, WASTE, WITH SWINGING TOP, 16" X 16"

# Equipment & Utility Plan Lockers, Toilet, & Shower Room (Clean Area, Women)

NOTE: THIS HANDICAPPED PLAN ALSO MAY BE USED FOR THE SOILED AREA OF SPD, BUT SHOULD BE CONSIDERED ON A PROJECT BASIS ONLY.

NOTE: PROVIDE STRUCTURAL SUPPORT AT CEILING FOR TOILET PARTITIONS

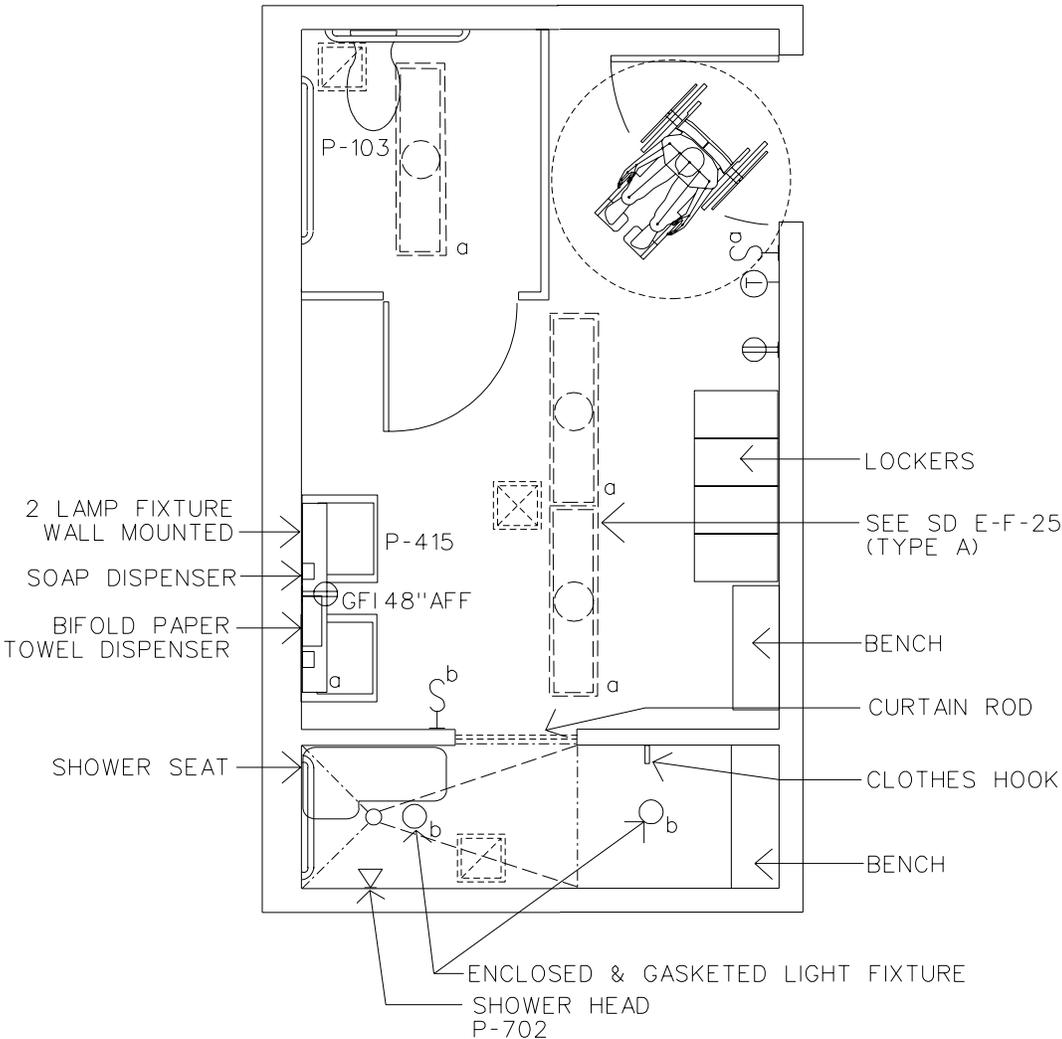

16 NSM  
173 NSF



# Design Standards

## Lockers, Toilet, & Shower Room (Clean Area)

### ARCHITECTURAL

Ceiling	PCP/AT	Wainscot	CT 1200 (4'-0")
Ceiling Height	2700 (9'-0")	Base	CT
Wall Finish	CT/GWB	Floor Finish	CT/VCT
Notes:		Slab Depression	-

SEPARATE FACILITIES FOR MEN AND WOMEN  
ENCLOSED TOILET

### ELECTRICAL

#### Lighting

General	30 FC - 2 W/SF
Special	-

Notes:

#### Power

General	400 W
Emergency	-

### COMMUNICATIONS

ADP	-	Telephone	-
Radio	-	Intercom	-
Notes:		Public Address	-

### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	-
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	-
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	NEGATIVE
Noise Criteria	NC-40	AC Load - Equipment	0.0929 W/SM
Steam	-	Number of People	2
Notes:		Special Exhaust	-

### PLUMBING AND MEDICAL GASES

Cold Water	YES	Sanitary Drain	YES
Hot Water	YES	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List


## Lockers, Toilet, & Shower Room (Clean Area)

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						LOCKERS, LOUNGE, TOILET AND SHOWER FACILITIES FEMALE
						NOTE: CONTIGUOUS TO SOILED RECEIVING AND DECONTAMINATION AREA.
T-B	CC	AR				LOCKER, STEEL, SLOPING TOP, 12"W X 21"D X 72"H (PG-08-1, MCS 10500; H-08-4, SD 61)
P-415	CC	1	2	2	1	LAVATORY, STRAIGHT BACK (PG-08-1, MCS 15450; H-08-4, SD 53)
	CC	1	2	2	1	MIRROR, 406 MM X 508 MM (16" X 20"), WITH INTEGRAL SHELF, OVER LAVATORY (PG-08-1, MCS 10800; H-08-4, SD 15)
	VV	1	2	2	1	DISPENSER, SOAP, LIQUID, WALL MOUNTED
	CC	1	2	2	1	DISPENSER, PAPER TOWEL AND DISPOSAL COMBINATION UNITS (PG-08-1, MCS 10800)
	CC	1	2	2	1	RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP, WITH GROUND FAULT INTERRUPTER, ADJACENT TO LAVATORY (PG-08-1, MCS 16140; H-08-3, CS 801-3)
						WHEELCHAIR WATER CLOSETS WILL BE IN ACCORDANCE WITH THE APPROPRIATE SPACE PROGRAM, P-103 WILL BE USED FOR BOTH CONVENTIONAL AND WHEELCHAIR INSTALLATIONS.
P-103	CC	1				WATER CLOSET, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				ENCLOSURE, TOILET, CEILING HUNG (PG-08-1, MCS 10162; H-08-3, CD 13; H-08-4, SD 12)
	CC	1				BAR, GRAB FOR WATER CLOSET (PG-08-1, MCS 10800; H-08-4, SD 12, 14B & 14F)
	CC	1				DISPENSER, TOILET TISSUE, DOUBLE ROLL (PG-08-1, MCS 10800; H-08-4, SD 12)
	CC	1				STALL, SHOWER (PG-08-1, MCS 10170; H-08-4, SD 13A)
P-702	CC	1				SHOWER, BATH FIXTURE, WALL MOUNTED, CONCEALED SUPPLIES (PG-08-1, MCS 15450; H-08-4, SD 13A)
	CC	1				ROD, CURTAIN, TUB OR SHOWER (PG-08-1, MCS 10800)
	CC	1				DISH, SOAP, SURFACE MOUNTED (PG-08-1, MCS 10800)
	CC	1	2	2	1	HOOK, TOWEL (PG-08-1, MCS 10800)
	CC	1				HOOK, CLOTHES (PG-08-1, MCS 10800)
	VV	1				HAMPER, SOILED LINEN, WITH HINGED SELF CLOSING TOP, 20" DIA.
	VV	1				RECEPTACLE, WASTE, WITH SWINGING TOP, 16" X 16"

# Equipment & Utility Plan Lockers, Toilet & Shower Room (Clean Area, Men)

NOTE: THIS HANDICAPPED PLAN ALSO MAY BE USED FOR THE SOILED AREA OF SPD, BUT SHOULD BE CONSIDERED ON A PROJECT BASIS ONLY.

NOTE: PROVIDE STRUCTURAL SUPPORT AT CEILING FOR TOILET PARTITIONS

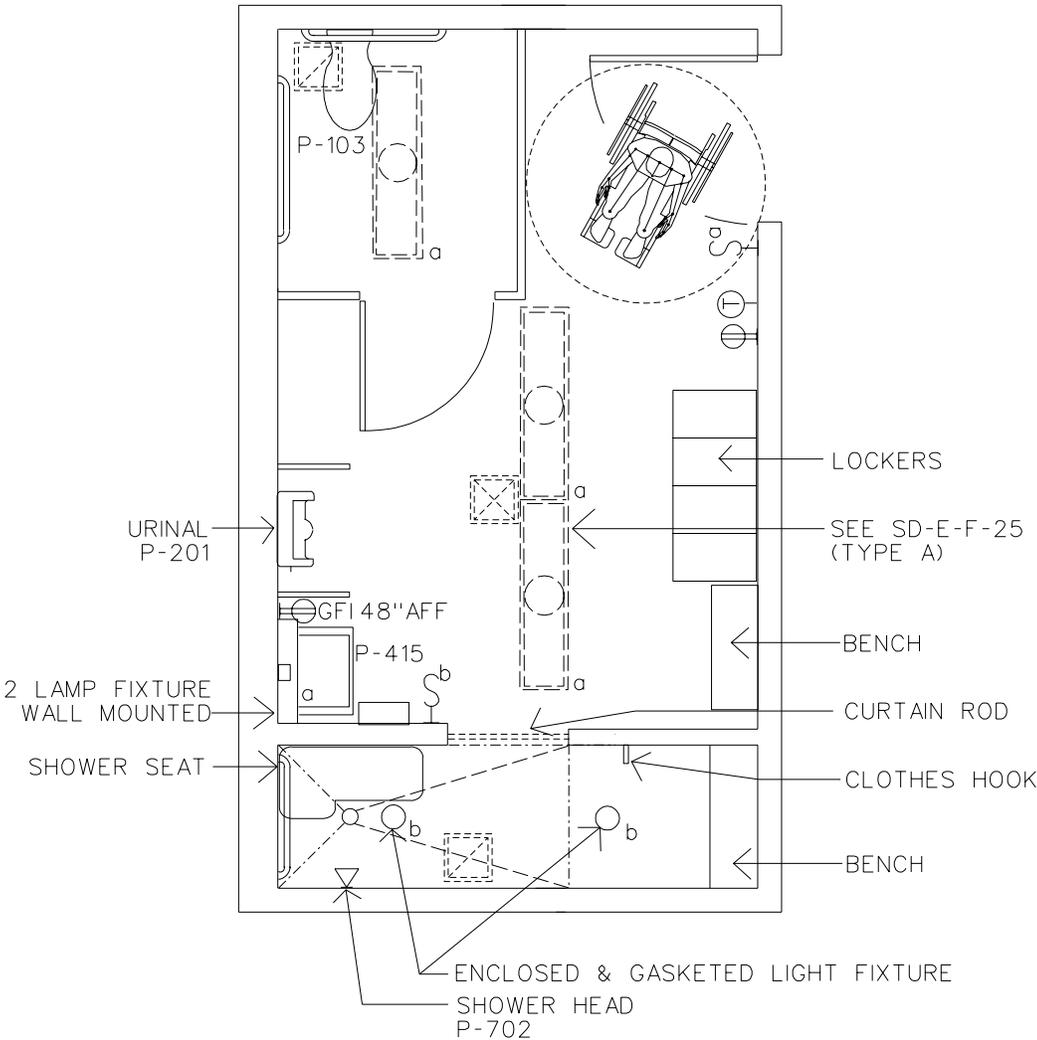

16 NSM  
173 NSF



# Design Standards

## Lockers, Toilet, & Shower Room (Clean Area)

### ARCHITECTURAL

Ceiling	PCP/AT	Wainscot	CT 1200 (4'-0")
Ceiling Height	2700 (9'-0")	Base	CT
Wall Finish	CT/GWB	Floor Finish	CT/VCT
Notes:		Slab Depression	-

SEPARATE FACILITIES FOR MEN AND WOMEN  
ENCLOSED TOILET

### ELECTRICAL

#### Lighting

General	30 FC - 2 W/SF
Special	-

Notes:

#### Power

General	400 W
Emergency	-

### COMMUNICATIONS

ADP	-	Telephone	-
Radio	-	Intercom	-
Notes:		Public Address	-

### HEATING, VENTILATING AND AIR CONDITIONING

Dry Bulb Temp Cooling F	76	Relative Humidity/Cooling	-
Dry Bulb Temp Heating F	72	Relative Humidity/Heating	-
Minimum % Outside Air	100	Minimum Air Changes/Hr	10
100% Exhaust Air	YES	Room Pressure	NEGATIVE
Noise Criteria	NC-40	AC Load - Equipment	0.0929 W/SM
Steam	-	Number of People	2
Notes:		Special Exhaust	-

### PLUMBING AND MEDICAL GASES

Cold Water	YES	Sanitary Drain	YES
Hot Water	YES	Reagent Grade Water	-
Laboratory Air	-	Medical Air	-
Laboratory Vacuum	-	Medical Vacuum	-
Other	-	Oxygen	-

Notes:

# Equipment Guide List

## Lockers, Toilet, & Shower Room (Clean Area)

SYMBOL	AI	QUANTITY				DESCRIPTION
		A	B	C	D	
						LOCKERS, LOUNGE, TOILET AND SHOWER FACILITIES - MALE
						NOTE: CONTIGUOUS TO SOILED RECEIVING AND DECONTAMINATION AREA.
T-B	CC	AR				LOCKER, STEEL, SLOPING TOP, 12"W X 21"D X 72"H (PG-08-1, MCS 10500; H-08-4, SD 61)
P-415	CC	1	2	2	1	LAVATORY, STRAIGHT BACK (PG-08-1, MCS 15450; H-08-4, SD 53)
	CC	1	2	2	1	MIRROR, 406 MM X 508 MM (16" X 20"), WITH INTEGRAL SHELF, OVER LAVATORY (PG-08-1, MCS 10800; H-08-4, SD 15)
	VV	1	2	2	1	DISPENSER, SOAP, LIQUID, WALL MOUNTED
	CC	1	2	2	1	DISPENSER, PAPER TOWEL AND DISPOSAL COMBINATION UNITS (PG-08-1, MCS 10800)
	CC	1	2	2	1	RECEPTACLE, ELECTRICAL, DUPLEX, 120 VOLT, 20 AMP, WITH GROUND FAULT INTERRUPTER, ADJACENT TO LAVATORY (PG-08-1, MCS 16140; H-08-3, CS 801-3)
						WHEELCHAIR WATER CLOSETS WILL BE IN ACCORDANCE WITH THE APPROPRIATE SPACE PROGRAM, P-103 WILL BE USED FOR BOTH CONVENTIONAL AND WHEELCHAIR INSTALLATIONS.
P-103	CC	1				WATER CLOSET, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				ENCLOSURE, TOILET, CEILING HUNG (PG-08-1, MCS 10162; H-08-3, CD 13; H-08-4, SD 12)
	CC	1				BAR, GRAB FOR WATER CLOSET (PG-08-1, MCS 10800; H-08-4, SD 12, 14B & 14F)
	CC	1				DISPENSER, TOILET TISSUE, DOUBLE ROLL (PG-08-1, MCS 10800; H-08-4, SD 12)
P-201	CC	1				URINAL, WALL HUNG (PG-08-1, MCS 15450; H-08-4, SD 4)
	CC	1				STALL, SHOWER (PG-08-1, MCS 10170; H-08-4, SD 13A)
P-702	CC	1				SHOWER, BATH FIXTURE, WALL MOUNTED, CONCEALED SUPPLIES (PG-08-1, MCS 15450; H-08-4, SD 13A)
	CC	1				ROD, CURTAIN, TUB OR SHOWER (PG-08-1, MCS 10800)
	CC	1				DISH, SOAP, SURFACE MOUNTED (PG-08-1, MCS 10800)
	CC	1	2	2	1	HOOK, TOWEL (PG-08-1, MCS 10800)
	CC	1				HOOK, CLOTHES (PG-08-1, MCS 10800)
	VV	1				HAMPER, SOILED LINEN, WITH HINGED SELF CLOSING TOP, 20" DIA.
	VV	1				RECEPTACLE, WASTE, WITH SWINGING TOP, 16" X 16"